




# Mechanical Equipment: Maximum Noise Levels City of Oakland

Mechanical equipment noise level in RH, RD, RM, RU-1, or RU-2 zones.

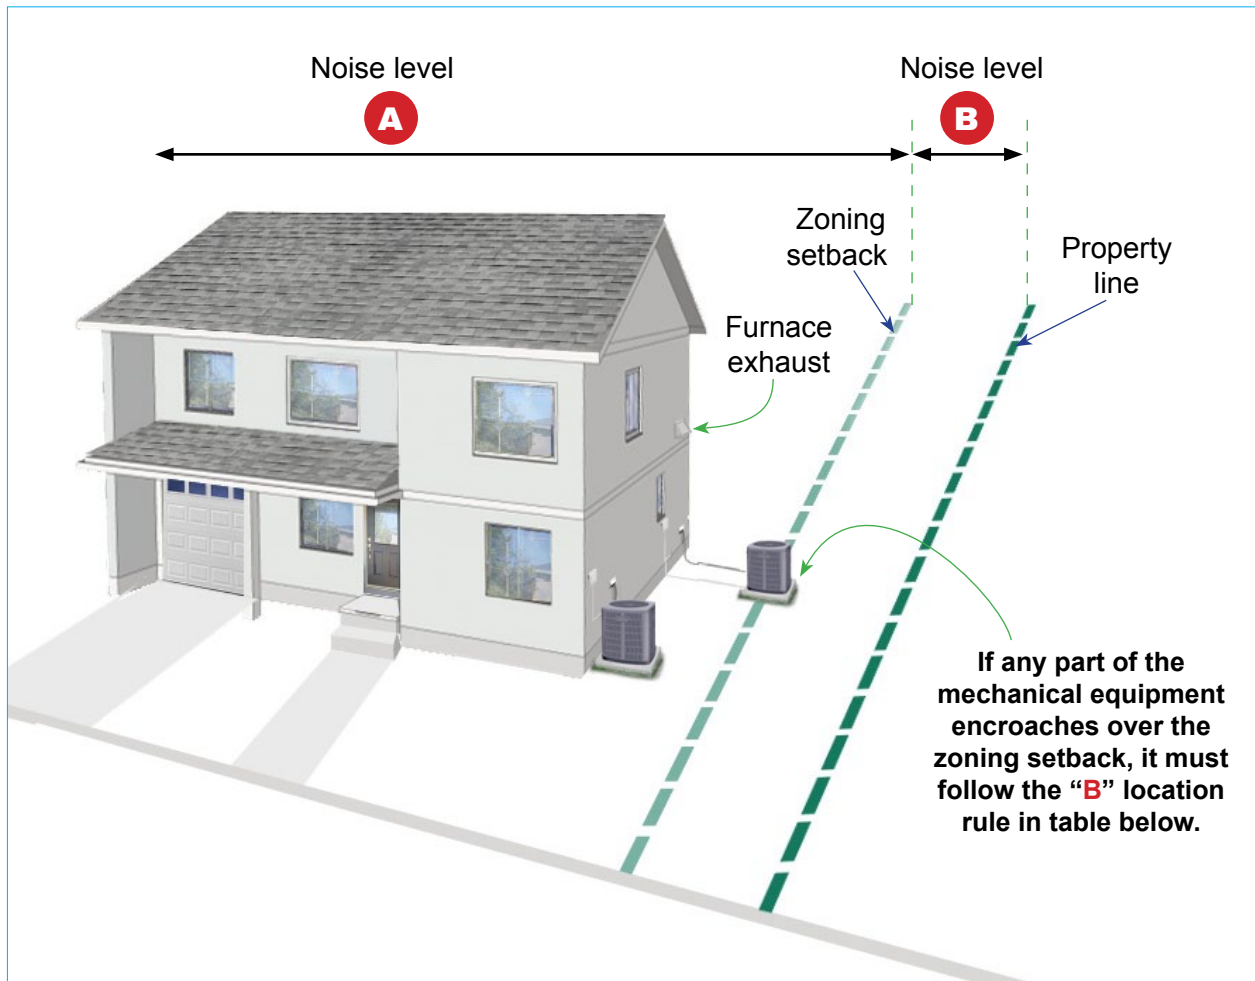

Mechanical Equipment	
LOCATION	MAXIMUM NOISE LEVEL EMITTED FROM EQUIPMENT
<b>A</b>	50 DBA (decibels) <b>OPC 17.120.050.H</b>
<b>B</b>	0 DBA <sup>1</sup> <b>OPC 17.108.130.I</b>

1. Air conditioners, compressors, hot tub motors, & similar devices if emitting noise readily noticeable by the average person at or beyond the lot line, whether or not the devices are attached to a building.  
(from the Oakland Planning Code table, 17.108,130, item I)